


Sample Only - DO NOT REPLICATE

Sample Only - DO NOT REPLICATE

Sample Only - DO NOT REPLICATE

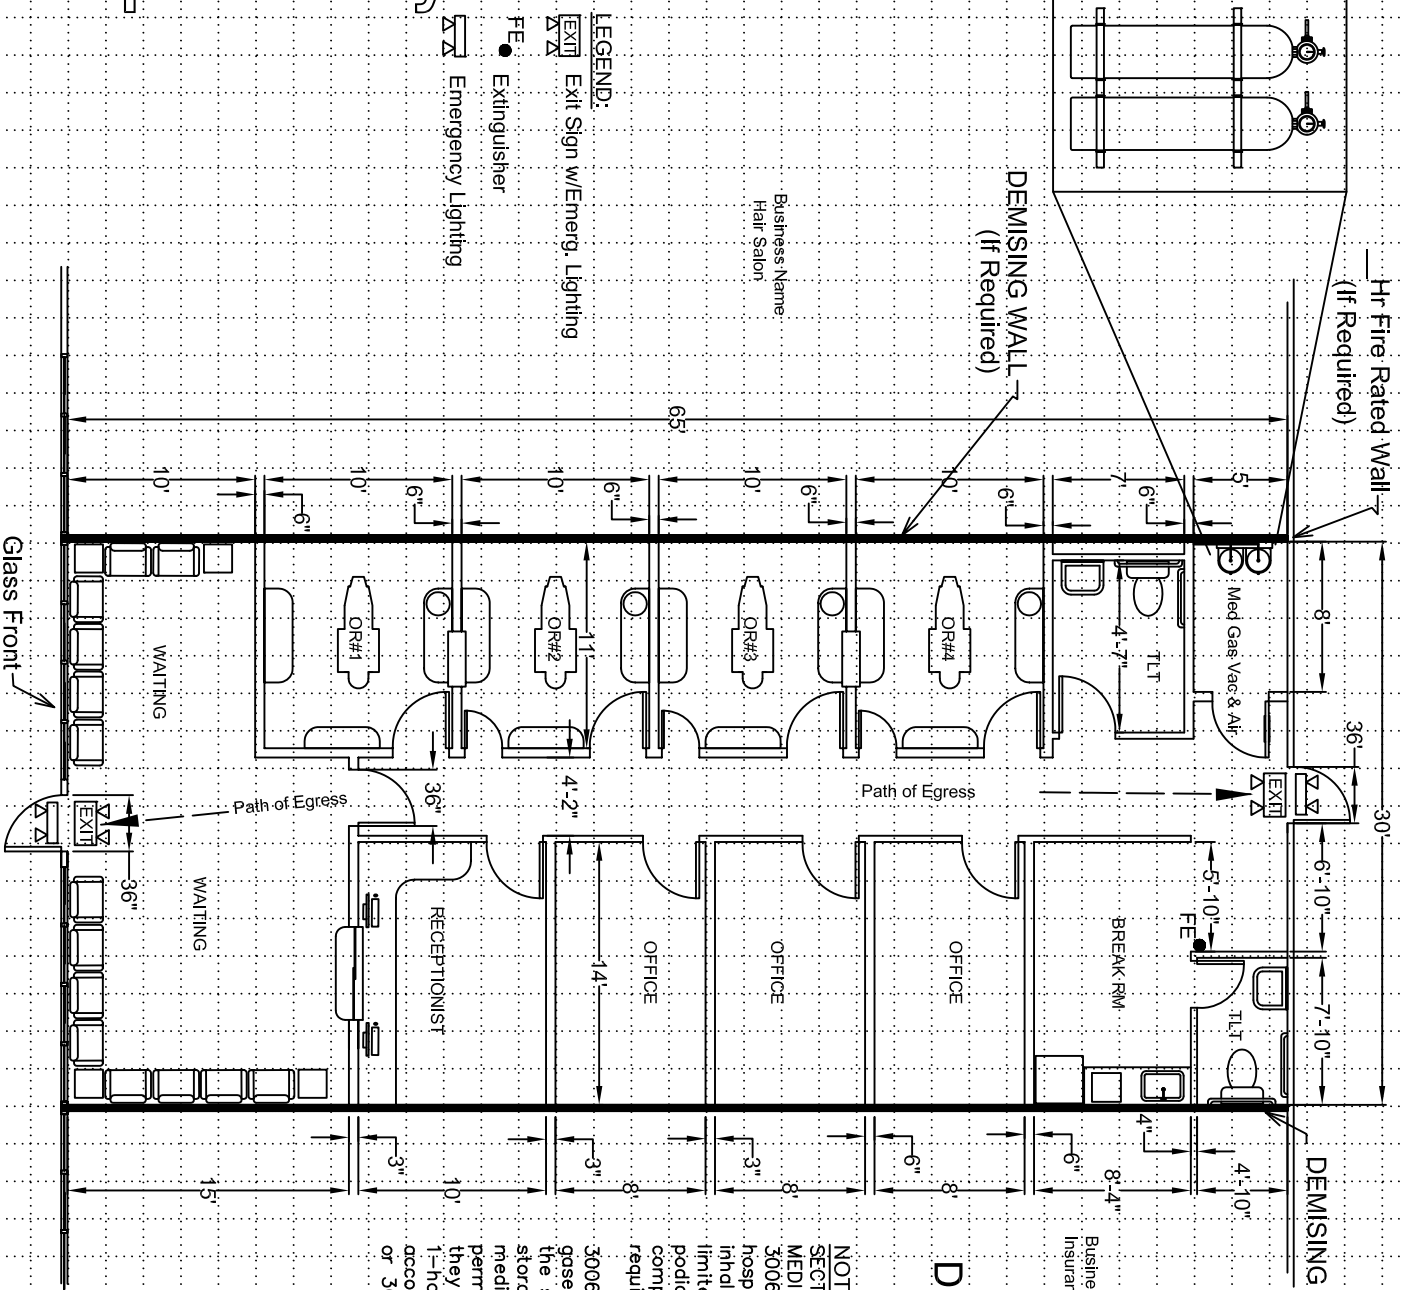

**DENTAL OFFICE**

**NOTES:**  
 SECTION: 3006  
**MEDICAL GAS SYSTEMS**  
 3006.1 General. Compressed gases at hospitals and similar facilities intended for inhalation or sedation including, but not limited to, radiology systems for dentistry, podiatry, veterinary and similar uses shall comply with this section in addition to other requirements of this chapter.  
 3006.2 Interior supply location. Medical gases shall be stored in areas dedicated to the storage of such gases without other storage or uses. Where containers of medical gases in quantities greater than the permit amount are located inside buildings, they shall be in a 1-hour exterior room, a 1-hour interior room or a gas cabinet in accordance with Section 3006.2.1, 3006.2.2 or 3006.2.3.

Sample Only - DO NOT REPLICATE

<b>LSBO</b> LEASE SPACE BUILD OUT PAGE # OF	PROJECT NAME: <u>My Dental Office</u>	CONTACT: <u>John Doe</u>
	ADDRESS: <u>123 Main St.</u>	ADDRESS: <u>321 South St.</u>
	CITY: <u>Houston</u> , TX ZIP: <u>77065</u>	CITY: <u>Houston</u> , TX ZIP: <u>77064</u> Ph. #: <u>713-555-1212</u>
	Scale: = 1'	